


-15kV TOF: -9116 v
 -3.6kV MCP: -2971 v
 -2.4kV MCP: -1589 v
 Input Cur: 310 ma
 RPA max: 237 v
 Mirror max: 238 v

Mon Sep 25 10:48:43 2006

TIDE Direct Events

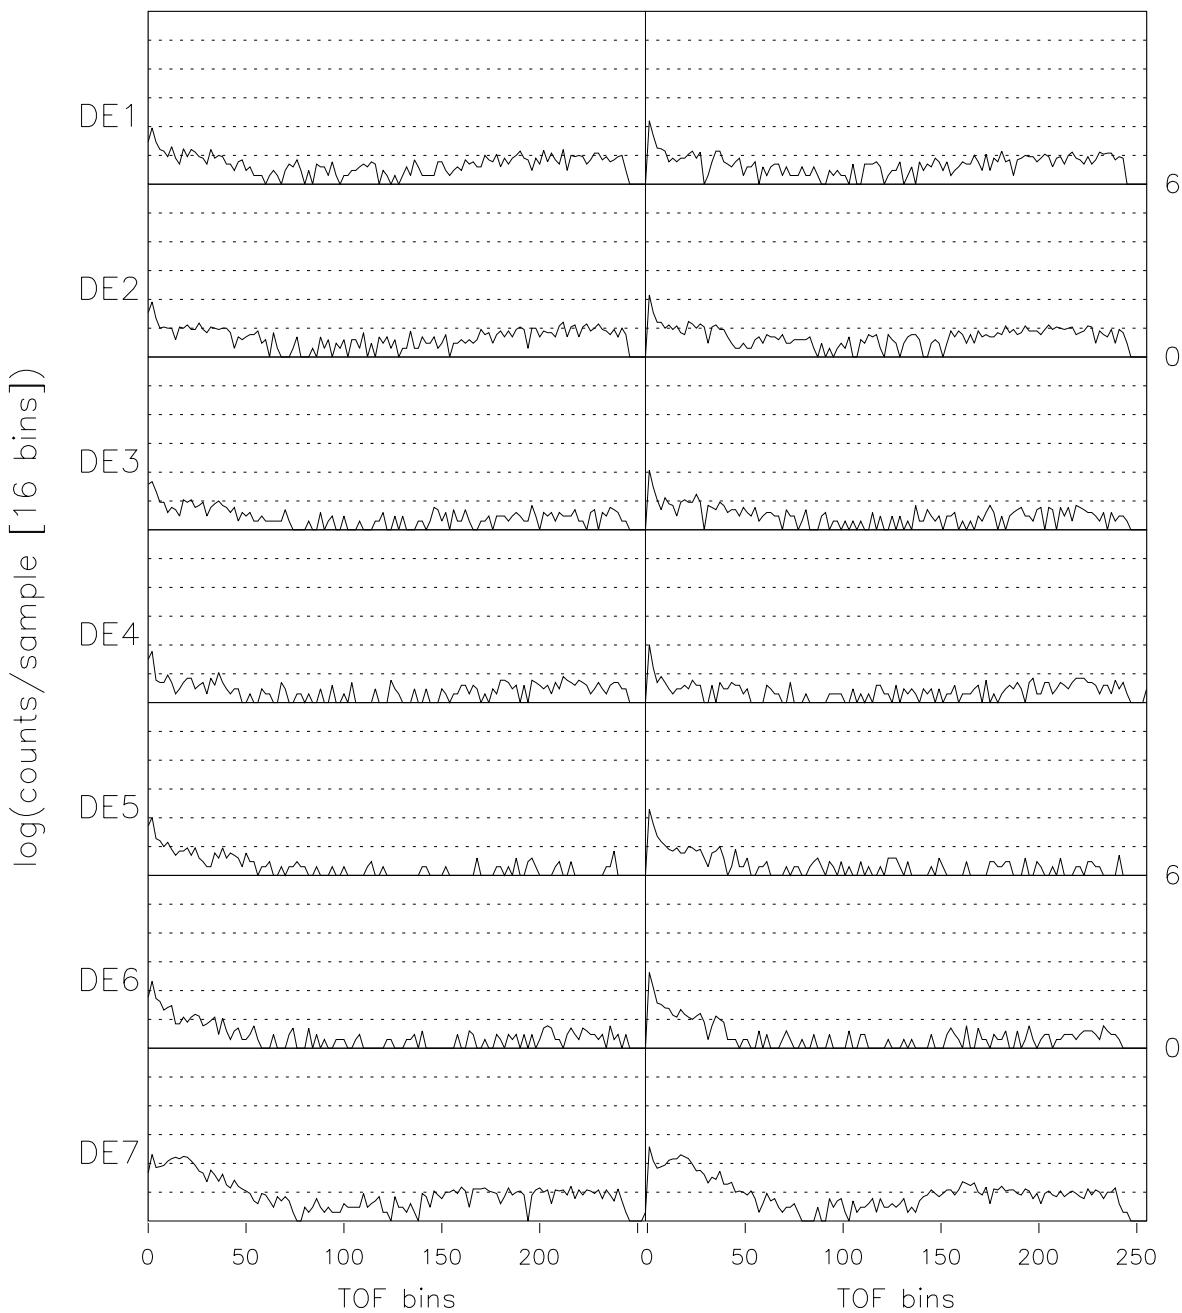

reported: 09-03-96 16:03:52 UT

reported: 09-03-96 16:07:04 UT

file: /export/data/tide/nrt/96090301.dat

-15kV TOF: -9116 v
-3.6kV MCP: -2923 v
-2.4kV MCP: -1579 v
Input Cur: 298 ma
RPA max: 236 v
Mirror max: 238 v